


South Jordan City

Composite drawing showing
Luminaire, Arm, and Pole

CATEGORY 1

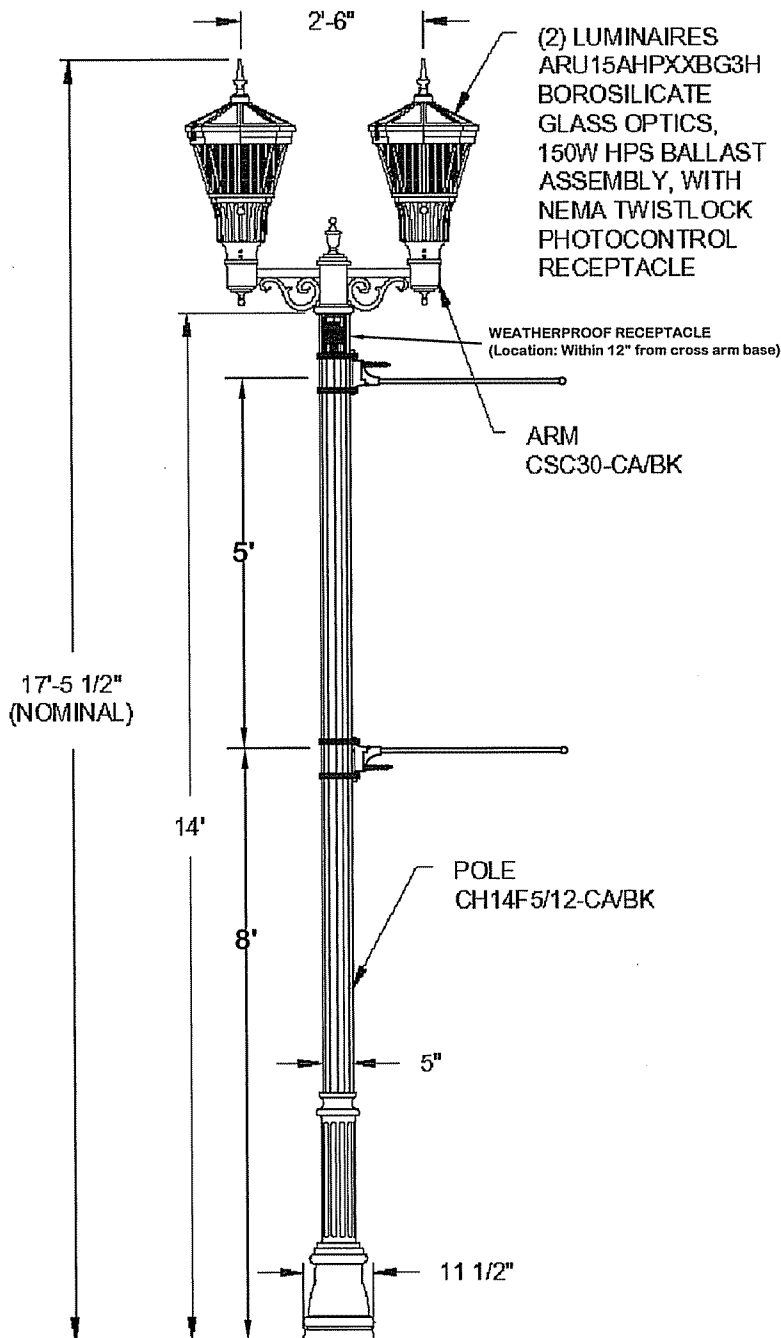

Specifications

LUMINAIRE DESCRIPTION

The Utility Arlington is designed for ease of maintenance with the plug-in electrical module common to each of the luminaires in Holophane's Utility Luminaire Series. A precision optical system maximizes post spacings while maintaining uniform illumination. For complete specifications, see drawing US-2584.

ARM DESCRIPTION

The crossarm shall be one-piece construction. The arms shall be welded to a center spool. All welding shall be per ANSI/AWS D1.2-90. All welders shall be certified per ANSI/AWS D1.2-90 Section 5. For complete specifications, see drawing US-2003.

POLE DESCRIPTION

The lighting post shall be all aluminum, one-piece construction, with a classic fluted base design. The shaft shall be 5" diameter fluted. The post shall be Holophane catalog number CH14F5/12-CA/BK. For complete specifications, see drawing US-1805.

WEATHERPROOF RECEPTACLE DESCRIPTION

A 20 amp, 125 volt, ground fault circuit interrupter duplex receptacle shall be mounted in the post. The receptacle shall be UL Listed according to E-8380 and UL 943 Class A and UL 498. The receptacle shall have a cast aluminum, lockable, UL Listed cover that is suitable for wet locations while in use and complies with NEC Article 410-57(b). The cover shall accept most common cord sets up to 1/2" diameter (12/3). The receptacle and cover shall mount to an outlet opening, in the post shaft, with a gasket and stainless steel screws. Catalog part # FGIUL-SXXH

BANNER ARM DESCRIPTION

The banner arm shall be a two-piece cast aluminum base black powder coated, black removable fiberglass banner arm with the patented spring release system black powder coated. The banner arm shall be the Banner Saver Pro 2000. The arm must be secured to pole using black powder coated hose clamps or equivalent. The bottom arm must be installed a minimum of 8' from pole base. Both banner arms shall be oriented perpendicular to sidewalk.

ARCHITECTURAL OUTDOOR ORDER #:

TYPE:

DRAWING NO: US-3246r1
PAGE 1 OF 4

THIS DRAWING, WHEN APPROVED, SHALL BECOME THE COMPLETE SPECIFICATION FOR THE MATERIAL TO BE FURNISHED BY HOLOPHANE ON THE ORDER NOTED ABOVE. A UNIT OF SIMILAR DESIGN MAY BE SUPPLIED, BUT ONLY AFTER APPROVAL BY THE CUSTOMER IN WRITING. ON POLE ORDERS AN ANCHOR BOLT TEMPLATE PRINT WILL BE SUPPLIED WITH EACH ANCHOR BOLT ORDER TO MATCH THE POLE PROVIDED.

THIS PRINT IS THE PROPERTY OF HOLOPHANE AND IS LOANED SUBJECT TO RETURN UPON DEMAND AND UPON EXPRESS CONDITION THAT IT WILL NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO OUR INTERESTS, AND ONLY IN CONNECTION WITH MATERIAL FURNISHED BY HOLOPHANE.

HOLOPHANE
LEADER IN LIGHTING SOLUTIONS

Holophane

A Division of National Service Industries, Inc.
214 OAKWOOD AVENUE - NEWARK, OHIO 43055

SCALE: N/A
DRAWN: RAF
APP'D:
DATE: 10-02-01